


# PARALLEL BACKFLOW PREVENTERS FOR FIRE LINE WHEN THE SERVICE CANNOT BE INTERRUPTED

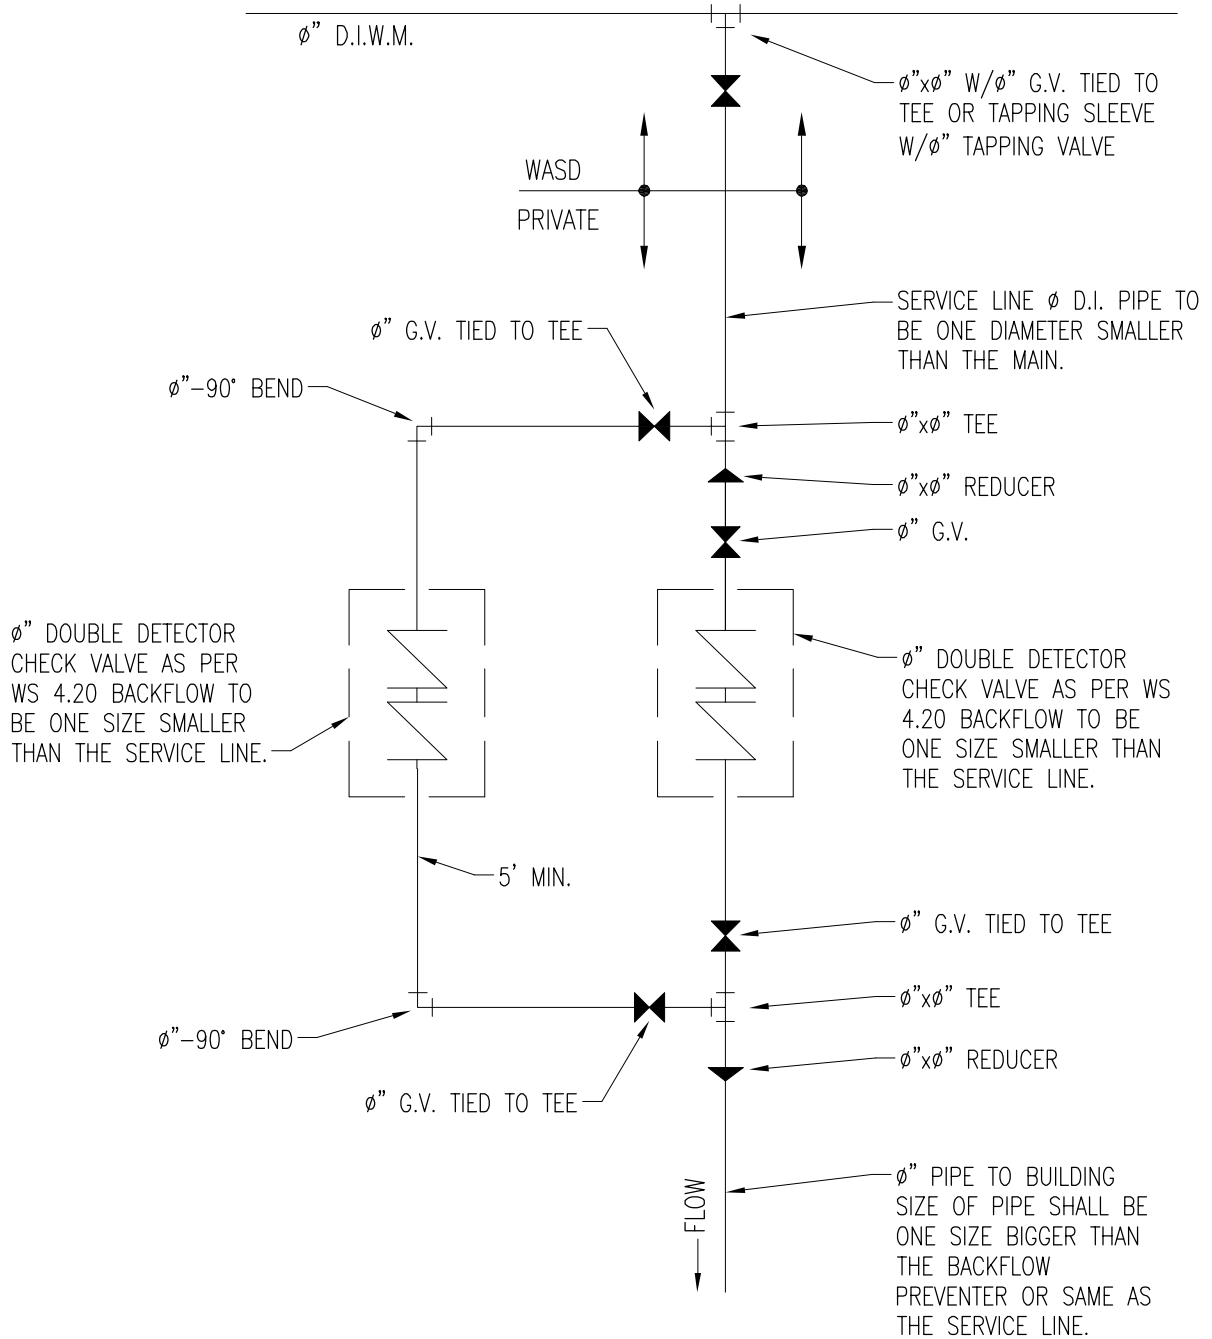

## NOTES:

1. SIZE OF FITTINGS WILL VARY ACCORDING TO SIZE OF WATER MAIN NEEDED ON SITE. ALSO, ORIENTATION VARIES ACCORDING TO LOCATION OF BUILDING.
2. IDENTIFY ALL NECESSARY WASD EASEMENTS ON DETAIL.
3. φ": DIAMETER (INCHES) & MATERIAL OF PIPE: DUCTILE IRON (D.I.).

GUARD POST DETAIL	WS 4.5	
I T E M	CROSS REF.	SPEC. REF.



<u>ISSUE DATE</u>	<u>APPROVED BY</u>
09/30/2009	V.F.C.

S T A N D A R D   D E T A I L

## DOUBLE DETECTOR CHECK VALVE IN PARALLEL

WS  
4.20

SHEET 4 OF 4