


PLAN VIEW

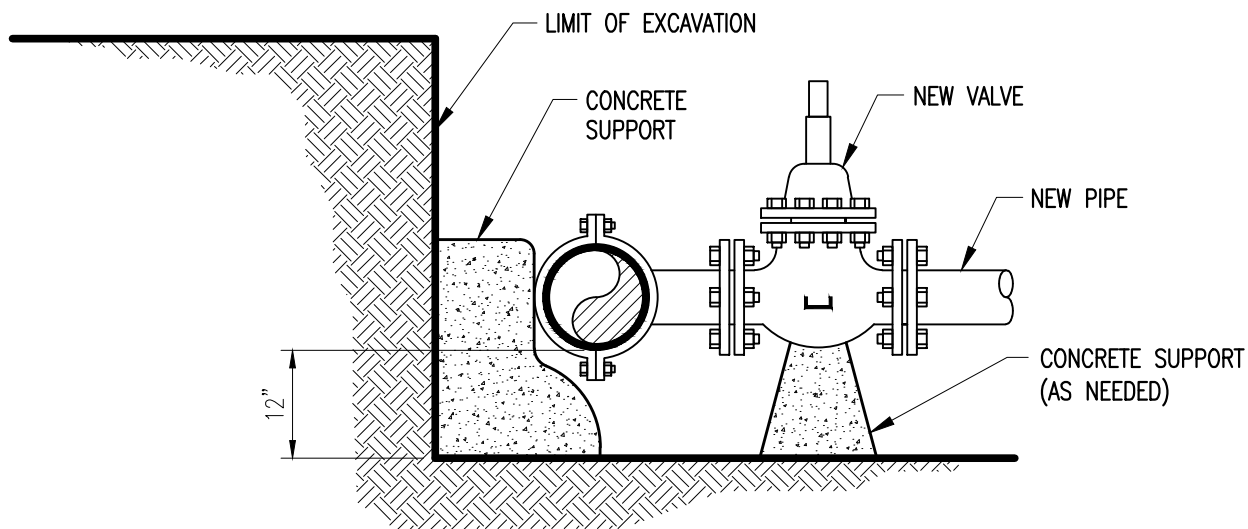

SECTION

PROCEDURE:

1. CONTRACTOR TO INSTALL AND PRESSURE TEST TAPPING SLEEVE AND VALVE, WITNESSED BY M-D.WASD INSPECTOR.
2. ALL TAPS LARGER THAN 20 INCHES SHALL BE DONE BY A TAPPING SPECIALIST WITH CREDENTIALS ACCEPTABLE TO THE DEPARTMENT.
3. CONTRACTOR TO SUPPLY EQUIPMENT TO HANDLE TAPPING MACHINE & DEWATERING EQUIPMENT.
4. 18" CLEARANCE FROM FITTINGS AND BELLS.
5. TAPPING VALVE AND SLEEVE SHALL BE PRESSURE TESTED AT 150 psi PRIOR TO BEING TAPPED.

ITEM	CROSS REF.	SPEC. REF.

 WATER & SEWER DEPARTMENT	ISSUE DATE	APPROVED BY	STANDARD DETAIL TAPPING SLEEVE AND VALVE INSTALLATION (PROPOSED)	GS 1.8 SHEET 1 OF 1
	01/22/2009	V.F.C.		
	07/20/2016	D.V.		